

Configured Valve Trains

Model VT10 (2-1/2" NPT)
Version 1

The Eclipse configured valve trains use a variety of shut-off valves, regulators, and associated components. These valve trains are rated for 110-120V / 50-60 Hz operation and are designed to meet the requirements of NFPA 86 - 2007 or XL Gaps (previously IRI IM.4.2.0). The XL Gaps version includes either a vent valve or a valve proving system. Standard components of all valve train sizes include safety shut-off valves, manual shut-off valves, high & low pressure switches, visual position indicators and pressure taps for valve seat leak testing and in-line strainers. Optional components consist of regulators, valve leak test systems, upstream and downstream gauges (2-1/2" face diameter) and pilot gas trains (1/2" or 3/8").

A standard configured valve train ordered with or without an agency designation does not guarantee compliance or noncompliance with the standard. The end-use application for the valve train determines any additional requirements to meet full compliance to the standards such as:

- Some components may require vent lines to a safe outside location.
- The customer gas supply shall have an isolation valve followed by a vertical drip leg of 3 pipe diameters but not less than 3".
- Also, external control devices may be used to meet the requirements of a standard. In this case, the valve train may need to be ordered with option X for NONE under Agency Approval to allow the most versatility in selection of component options.

Component ³	Enclosure Rating (NEMA)	Maximum Operating Pressure PSI	Temperature Limits °F	Agency					Comments
				U L L	U L R	C S A	F M	C E	
Eclipse 2000 AT Valves	1, 2, 3, 3S, 4, 12 & 13	30	-20 to 150	•		•	•		Iron Body
Siemens VGD w/ SKP Actuators	1, 2, 5, & 12	10	15 to 140	•		•	•		Aluminum Body
Manual Shut-Off Valve	N/A	600	-40 to 366	•		•	•		Brass w/ Teflon Seals
Pressure Switches ¹	1, 4, & 12	7	-40 to 140	•		•	•		Auto or Manual Reset
Vent Valve (1-1/4")	1, 2, 3, 3S, 4, & 4X	5	-40 to 125	•		•			Aluminum Body
Valve Proving System (VDK)	12	5	15 to 140			•	•	•	Aluminum Housing
Pressure Regulator (Sensus) ²	N/A	15, 125, 150	-20 to 150						Cast Iron Body



¹ Switches for 40" to 200" w.c. are rated for 14 psi max. and -22°F to 140°F.

² Operating pressure depends on model selected.



³ Refer to manufacturer's datasheet for component details.

Dimensions & Specifications

Eclipse Safety Shut Off Valves

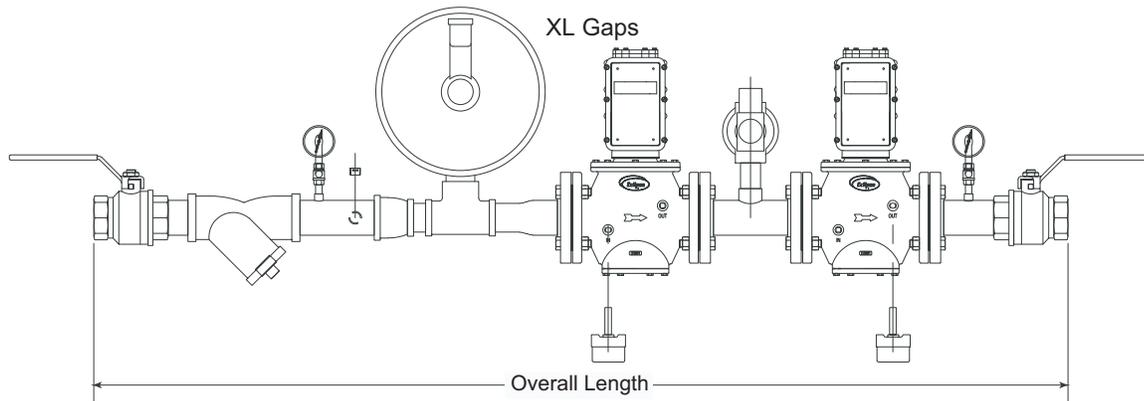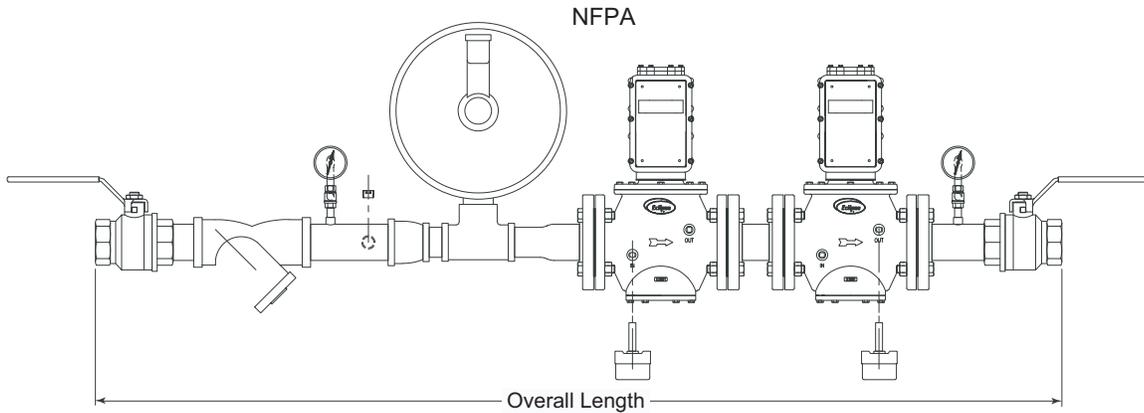

Siemens Shut Off Valves

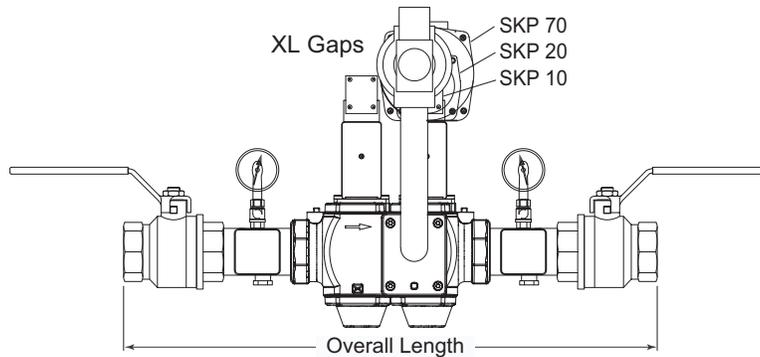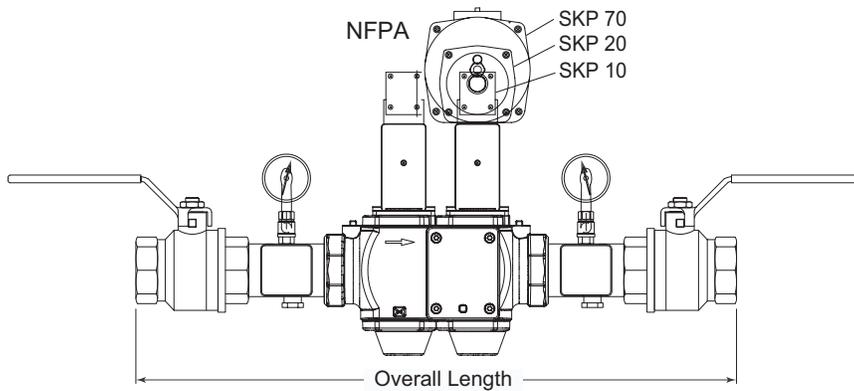

When using the Siemens SKP20 and SKP70 actuators for pressure regulating and ratio regulating functions, the sensing piping is not included. For proper operation, the sensing pipe should be at least 1/4" ID and connected a minimum of 5 pipe diameters downstream in a non-turbulent area.

WARNING: For proper and safe operation, the installer must read and thoroughly understand the Siemens Technical Instructions 155-514P25 for the SKP20 and 155-516P25 for the SKP70.


Dimensions & Specifications (continued)

2-1/2" NPT Valve Train Arrangements	Overall Length		Δp ("w.c.) through (2) Safety Shut-off Valves @ 13000 scfh	Enclosure Rating (NEMA)	Temperature Range °F	SSOV Maximum Operating Pressure (PSI)**
	Minimum	Maximum				
Eclipse NFPA	1883 mm (74.1")	1999 mm (78.7")	9.8	4	-20 to 140	7
Eclipse XL Gaps w/ Vent Valve	1984 mm (78.1")	2100 mm (82.7")	9.8	1	-20 to 125	5
Siemens NFPA	774 mm (30.5")	890 mm (35.0")	11.2	12	15 to 140	7
Siemens XL Gaps w/ Vent Valve	774 mm (30.5")	890 mm (35.0")	11.2	12	15 to 140	5

* Eclipse XL Gaps with valve proving system differs with an enclosure rating of NEMA 12, a temperature range of 15° to 140°F, and a shorter overall length.

** Depending on components selected, pressure switches, etc.

Capacities

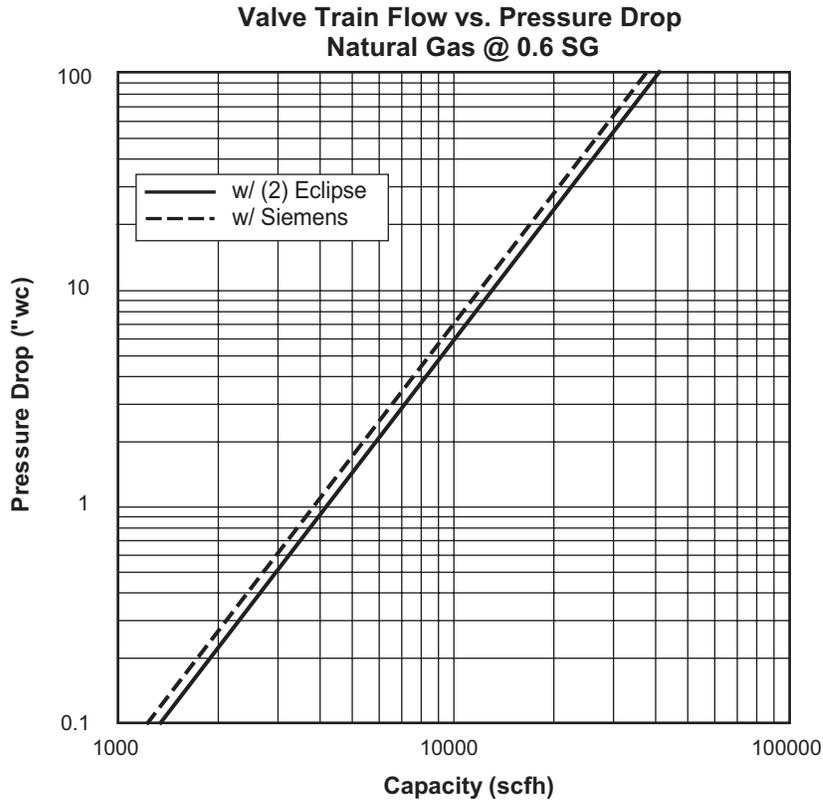



Offered By:

Power Equipment Company
2011 Williamsburg Road
Richmond, Virginia 23231
Phone (804) 236-3800
Fax (804) 236-3882

www.peconet.com